


This USG System Detail must not be used without a complete evaluation by owner's design professional to verify the suitability of its use with your specific application.

Construction Solution Details: Fire Sprinkler Installed in Panel

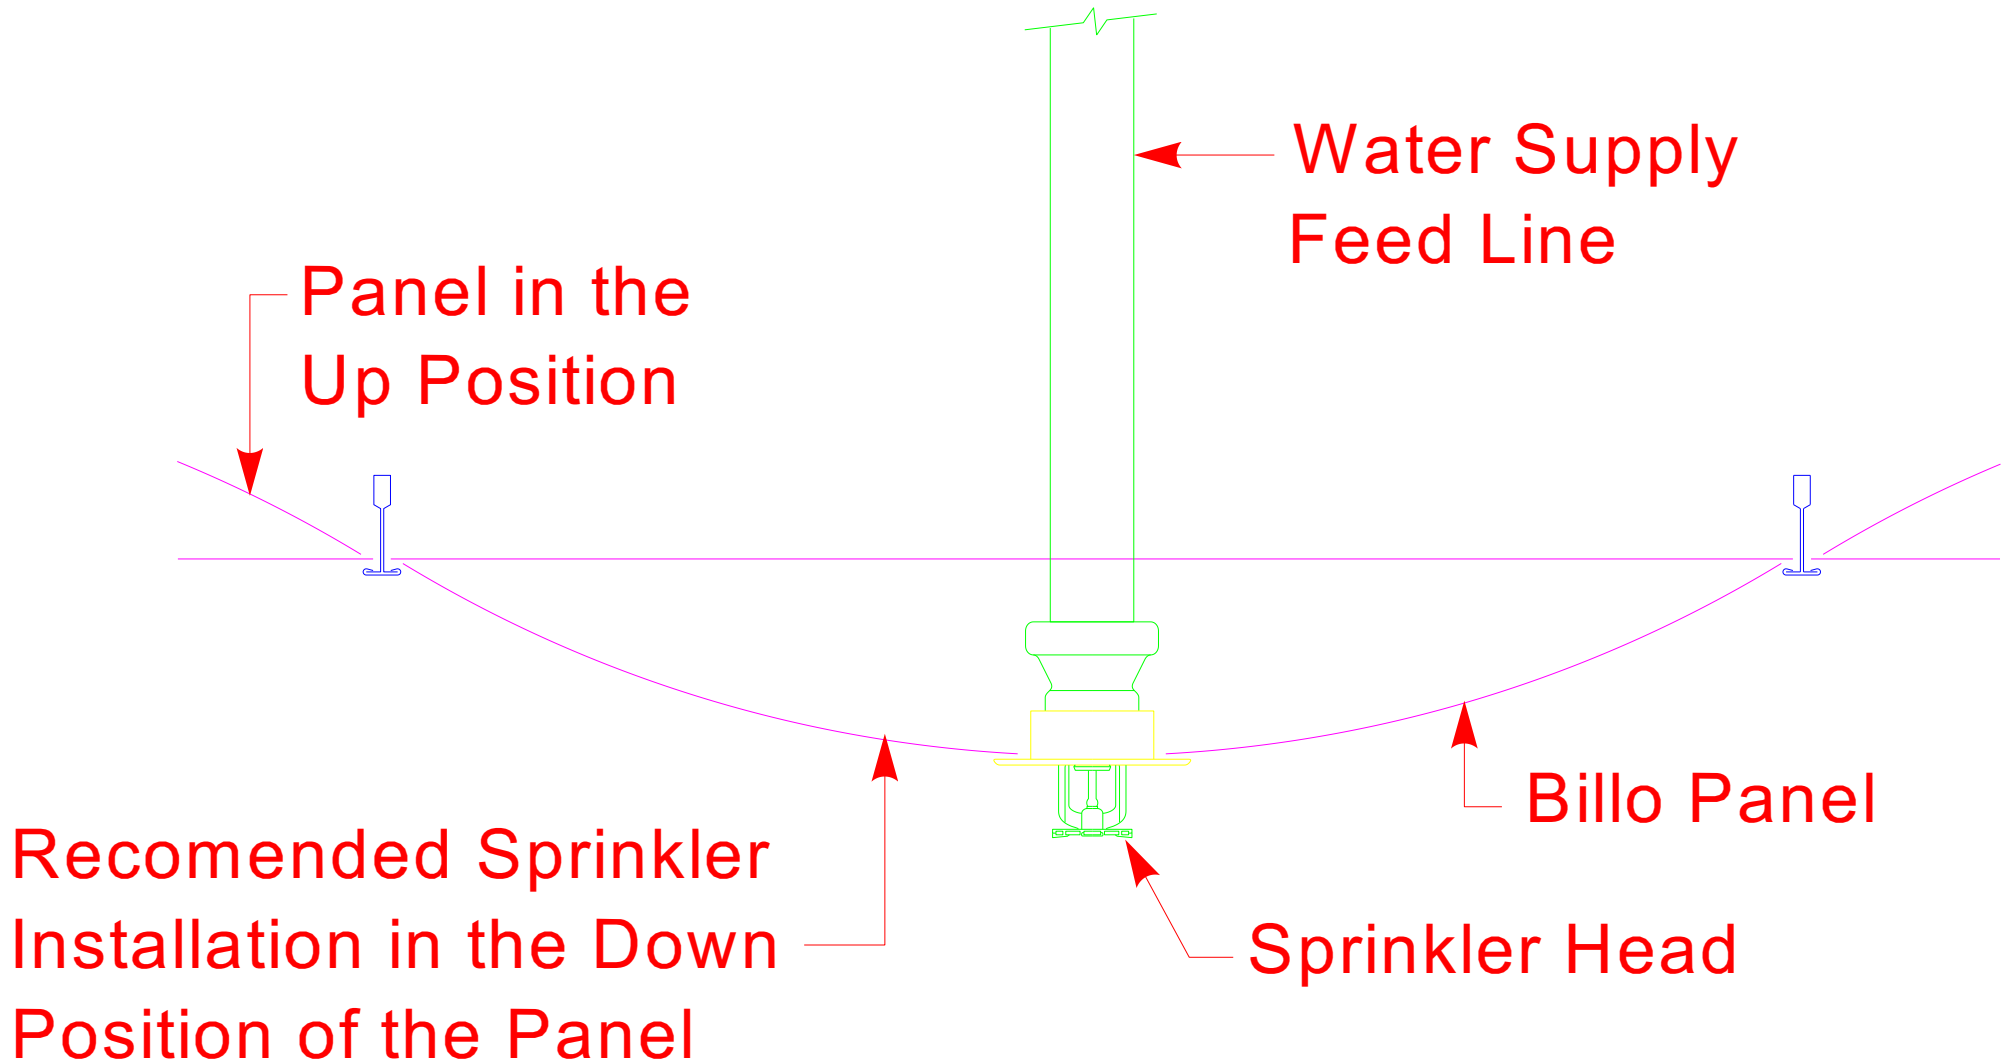


USG Corporation
125 South Franklin Street
Chicago, IL 60606-4678

Architectural and Technical Solutions
800-874-4968

Drawn by: SG
Approved: SM
Revision:
Scale: Not to Scale

Date: June 20, 2006
Date:
Change:
Project:
File: 091500044



Water Supply
Feed Line

Panel in the
Up Position

Billo Panel

Sprinkler Head

Recomended Sprinkler
Installation in the Down
Position of the Panel