

EVALUATING JOBSITE ENVIRONMENTAL CONDITIONS

The ideal conditions for the installation, finishing and decorating of USG Sheetrock® Brand Gypsum Panel and USG Fiberock® Brand Panel systems are those that closely match the intended occupancy environment. This level of temperature, humidity, ventilation, and free moisture should be maintained continuously before stocking, during installation and after the completion of the finishing and decorating processes. Sharp swings in temperature, ventilation, and/or humidity, like those that occur when environmental control systems are turned off at night or on weekends, should be avoided. Rapid changes in environmental conditions cause thermal and hygrometric movement which is likely to cause cracking, bond loss or other problems.

USG does not offer or provide construction supervision or inspection services as it relates to the installation of our products or to evaluate jobsite environmental conditions. However, USG is available to assist its customers in understanding how USG products and systems should be applied or installed. This is accomplished through the review of USG product literature and USG system installation recommendations at the jobsite or an off-site location. If it's determined that inspection services are required by the owner, general contractor, or sub-contractor, then they should secure the services of an independent third party provider.

There are a number of industry standards for evaluating your current job conditions. Foremost among these is USG's Gypsum Construction Handbook. In addition, the Drywall Finishing Council (DWFC), Gypsum Association (GA), Association of the Wall and Ceiling Industry (AWCI), and the Painting and Decorating Contractors of America (PDCA), and Ceilings & Interior Systems Construction Association (CISCA) have a variety of papers and literature that discuss interior finishing problems associated with poor jobsite environmental conditions.

POOR JOBSITE CONDITIONS CREATE MOVEMENT

Simply put, movement comes in three forms: thermal, hygrometric and structural.

- Thermal movement is created by the expansion or contraction of building materials with changes in temperature. All materials expand/contract by different amounts and rates as temperatures vary.
- Hygrometric movement is caused by the absorption or evaporation of water by the building materials. As with thermal movement, different materials absorb or release moisture at different rates as environmental conditions change. This function is greatly affected by the temperature and humidity of the space and the result is expansion/contraction as the moisture is absorbed and released by the materials.
- Structural movement is caused by dimensional changes and the physical shifting of building components. This form of movement is commonly associated with foundation settling or actual building movement due to wind or seismic forces, but can also occur within the building due to loading and environmental changes. In high-rise construction, shortening (i.e. compression) of the columns occurs in the lower levels as the weight of the upper floors increases. The building structure also grows and shrinks as temperatures rise and fall with seasonal changes. Lumber shrinkage and changes in relative humidity in wood framed construction can cause physical movement, primarily in the cross-grain direction.

EXAMPLES OF LEVELS OF MOVEMENT FOR COMMON BUILDING MATERIALS

40 to 100 °F (4 to 38 °C), in./in./°F

Gypsum Panels and Bases, Paper-Faced	9.0E-06
Gypsum Panels and Bases, Glass-Faced	8.5E-06
Gypsum Fiber-Reinforced Panels	7.0E-06
Gypsum Plaster, Sanded (100:2, 100:3)	6.8E-06
Gypsum Plaster, Wood Fiber (sanded 100:1)	8.0E-06
Gypsum Plaster, Perlited	7.4E-06
Gypsum Plaster, Vermiculite (sanded 100:2)	8.6E-06
Aluminum, Wrought	1.3E-05
Steel Framing, Typical (non-structural)	6.7E-06
Brick, Masonry	3.1E-06
Cement Board	7.9E-06
Cement, Portland	5.9E-06
Concrete	7.9E-06
Spruce Pine Fir (parallel to fiber)	2.1E-06
Spruce Pine Fir (perpendicular to fiber)	3.2E-06

Coefficient

Thermal Coefficients of Linear Expansion of Common Building Materials							
Change in Length (in.) for Δ 20° Temperature Change							
	10 (LFT)	20 (LFT)	50 (LFT)	80 (LFT)	90 (LFT)	100 (LFT)	120 (LFT)
9.0E-06	0.022	0.043	0.108	0.173	0.194	0.216	0.259
8.5E-06	0.020	0.041	0.102	0.163	0.184	0.204	0.245
7.0E-06	0.017	0.034	0.084	0.134	0.151	0.168	0.202
6.8E-06	0.016	0.033	0.082	0.131	0.147	0.163	0.196
8.0E-06	0.019	0.038	0.096	0.154	0.173	0.192	0.230
7.4E-06	0.018	0.036	0.089	0.142	0.160	0.178	0.213
8.6E-06	0.021	0.041	0.103	0.165	0.186	0.206	0.248
1.3E-05	0.031	0.061	0.154	0.246	0.276	0.307	0.369
6.7E-06	0.016	0.032	0.080	0.129	0.145	0.161	0.193
3.1E-06	0.007	0.015	0.037	0.060	0.067	0.074	0.089
7.9E-06	0.019	0.038	0.095	0.152	0.171	0.190	0.228
5.9E-06	0.014	0.028	0.071	0.113	0.127	0.142	0.170
7.9E-06	0.019	0.038	0.095	0.152	0.171	0.190	0.228
2.1E-06	0.005	0.010	0.025	0.040	0.045	0.050	0.060
3.2E-06	0.008	0.015	0.038	0.061	0.069	0.077	0.092

40 to 100 °F (in./in./°F)

Example: Gypsum Panels

$$(9.0E-06) \times (10 \text{ ft} \times 12 \text{ in./ft}) \times (20 \text{ Deg F change}) = 0.022 \text{ inches of expansion}$$

5% - 90% RH (in./in./%RH)

Gypsum Panels and Bases, Paper-Faced	7.2E-06
Gypsum Panels and Bases, Glass-Faced	6.3E-06
Gypsum Fiber-Reinforced Panels	3.5E-06
Gypsum Plaster, Sanded (100:2, 100:3)	1.5E-06
Gypsum Plaster, Wood Fiber (sanded 100:1)	2.8E-06
Gypsum Plaster, Perlited	4.8E-06
Gypsum Plaster, Vermiculite (sanded 100:2)	3.8E-06
Cement Board (50%-90% RH)	1.0E-05
Spruce Pine Fir (parallel to fiber)	1.0E-06
Spruce Pine Fir (perpendicular to fiber)	3.2E-04

Coefficient

Hygrometric Coefficients of Expansion (Unrestrained)							
Change in Length (in.) for Δ 20° Temperature Change							
	10 (LFT)	20 (LFT)	50 (LFT)	80 (LFT)	90 (LFT)	100 (LFT)	120 (LFT)
7.2E-06	0.017	0.035	0.086	0.138	0.156	0.173	0.207
6.3E-06	0.015	0.030	0.075	0.120	0.135	0.150	0.180
3.5E-06	0.008	0.017	0.042	0.067	0.076	0.084	0.101
1.5E-06	0.004	0.007	0.018	0.029	0.032	0.036	0.043
2.8E-06	0.000	0.013	0.034	0.054	0.060	0.067	0.081
4.8E-06	0.012	0.023	0.058	0.092	0.104	0.115	0.138
3.8E-06	0.009	0.018	0.046	0.073	0.082	0.091	0.109
1.0E-05	0.024	0.048	0.120	0.192	0.216	0.240	0.288
1.0E-06	0.002	0.005	0.012	0.019	0.022	0.024	0.029
3.2E-04	0.768	1.536	3.840	6.144	6.912	7.680	9.216

5%-90% RH (in./in./% RH)

Example: Gypsum Panels

$$(7.2E-06) \times (10 \text{ ft} \times 12 \text{ in./ft}) \times (20 \text{ Deg F change}) = 0.017 \text{ inches of expansion}$$

**EFFECTS OF POOR
ENVIRONMENTAL CONDITIONS ON
GYPSUM PANEL SYSTEMS**


The following problems may result from poor environmental conditions:

- **Ridging**—This is the result of hygrothermal expansion in which the movement causes adjacent panels to press tightly against each other. The resulting stresses are relieved by the panel edges bending outward in the region of the joint. It is a progressive deformation that appears as a continuous ridge along the length of the joint, with a uniform, fine, ridge-like pattern in the center.
- **Starved Joints**—Failure to allow time for the initial coats of compound to dry adequately results in poor drying conditions in which the subsequent coats of compound further delay the drying of underlying coats. This causes compound shrinkage to occur after it was thought the joint was completed and the joint appears to have insufficient compound applied or appears “starved.”
- **Joint Edge Cracking**—Cracks along the edges of the tape can be caused by too rapid drying due to high temperatures accompanied by low humidity or excessive drafts, or by cold wet application conditions resulting in poor bond.
- **Joint Cracking**—Cracks in the center of flat or angle joints are typically the result of some form of movement. That movement can be thermal, hygrometric or structural in nature.
- **Screw Depressions**—These are low spots over the heads of nails or screws and may be caused by a very slight swelling of the adjacent paper. This is caused by excessive humidity, free moisture and/or temperature creating poor drying conditions. The extended drying time causes the panels to absorb extra moisture, softening the core and causing the paper surrounding the fasteners to swell slightly. Large increases in relative humidity after the gypsum panels have been installed can also result in moisture absorption and slight swelling of the paper. Failing to use a graduated arc of compound or applying the compound flush to the surface will accentuate this phenomenon. Please refer to USG’s *Finishing and Decorating Gypsum Panels* (J2010/11-10) for more information.
- **Fastener Pops**—Caused by shrinkage in framing lumber. The tip of the fastener remains anchored in the stud as the surface of the stud shrinks away from the back of the gypsum panel. This leaves the fastener extending out away from the framing with the panel slightly loose. Pressure exerted on the panel causes it to close the gap, between the panel and the stud, and the result is joint compound over the fastener head protrudes from the surface of the panel.
- **Mold Potential**—Poor jobsite conditions create a greater potential for the growth of mold on building products. Excessive free water, high humidity, poor ventilation, and temperature extremes extend drying times, thereby exposing materials to elevated moisture conditions for longer than normal. Such abnormal exposures can result in conditions conducive to mold growth.
- **Bond Loss**—The absorption of excessive moisture into building materials can lead to bond loss as that moisture dries out. This can happen to moist panels where joint compounds, paint, or other wallcovering products have been applied.
- **Final Appearance Defects**—The final appearance of a wall or ceiling system can be negatively affected by poor jobsite conditions. Varying drying times can lead to paint color/texture variations, sheen differences, joint telegraphing, and even bubbling of the finish paint in areas where the previous coat of paint still contains significant moisture.

RISK ASSESSMENT METHODS

Joint Compound Drying Time Chart

The color coded graph provides a simple reference to evaluate the risk levels at the respective temperature and humidity levels on the jobsite. It should be noted that the environmental factors vary from room to room on any jobsite and should be thoroughly measured. The colors indicate the relative drying conditions and the dashed lines indicate the various estimated drying times based on the relative humidity and temperature indicated. The chart is an approximate representation of the amount of time it will take for a single, nominal 1/16" coat of compound to dry. The time will vary based on the thickness of the compound and the amount of airflow/exchange that is occurring in the space. While the chart shows temperatures lower than 55°F, USG recommendations require that the temperature be maintained at or above 55°F during the entire finishing process and until the compound is completely dry.

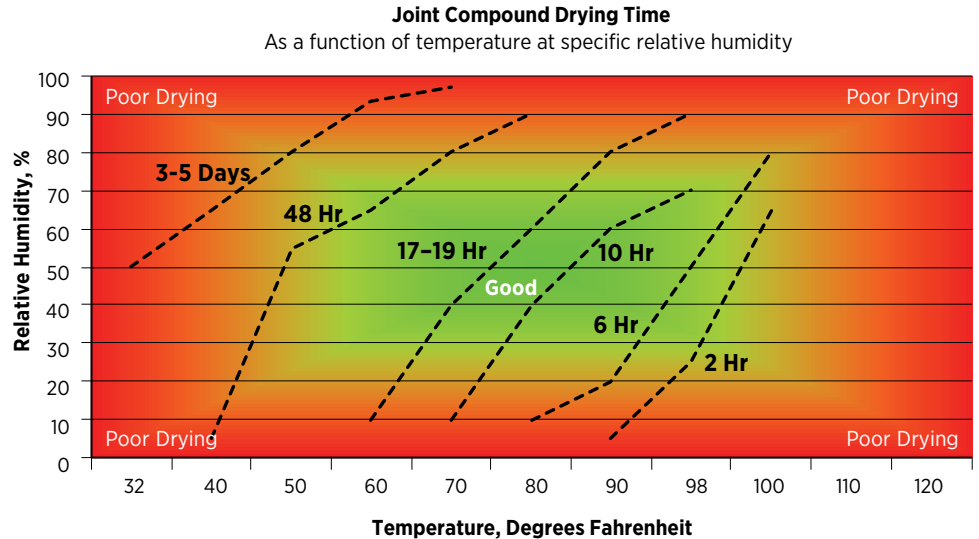

Optimal

Green-shaded areas are considered to be good jobsite environmental conditions that provide for efficient drying conditions. The likelihood of drying-related problems in this area are small.

Marginal

Yellow-shaded areas are considered to be fair conditions for finishing but some finishing and decorating problems may occur. Slight ridging, hairline edge cracking, joint telegraphing, and slight screw depressions are possible. Failure to improve the jobsite conditions may result in the need to perform extra work or repairs to achieve a suitable finished appearance.

Poor

Red-shaded areas are those conditions where stocking, hanging, finishing, and decorating operations should not be done. Problems will result and extensive extra work or repairs will almost certainly be needed.

RISK ASSESSMENT METHODS, CONT.

Dew Point

Using the dew point temperature is another method of evaluating the jobsite environmental conditions. The dew point is the temperature at which moisture will condense on a surface. It is determined by measuring the temperature and relative humidity of the room air. No joint compounds or coatings should be applied unless the surface temperature is at least 5°F (3°C) above the dew point temperature of the room air. This requires measuring the surface temperature of the wall, as well as the temperature and relative humidity of the air in order to determine the dew point. There are a number of inexpensive, portable devices for measuring this. It should be noted that the surface temperature must be maintained above the dew point throughout the curing process.

Dew Point Calculation Chart											
Ambient Air Temperature °F											
	20	30	40	50	60	70	80	90	100	110	120
90	18	28	37	47	57	67	77	87	97	107	117
85	17	26	36	45	55	65	75	84	95	104	113
80	16	25	34	44	54	63	73	82	93	102	110
75	15	24	33	42	52	62	71	80	91	100	108
70	13	22	31	40	50	60	68	78	88	96	105
65	12	20	29	38	47	57	66	76	85	93	103
60	11	19	27	36	45	55	64	73	83	92	101
55	9	17	25	34	43	53	61	70	80	89	98
50	6	15	23	31	40	50	59	67	77	86	94
45	4	13	21	29	37	47	56	64	73	82	91
40	1	11	18	26	35	43	52	61	69	78	87
35	-2	8	16	23	31	40	48	57	65	74	83
30	-6	4	13	20	28	36	44	52	61	69	77

Example: Temperature of 70°F and relative humidity of 65% results in a dew point of 57°F. No joint compounds or coatings should be applied in this case unless the surface temperature is at least 62°F.

RESPONSIBILITIES

It is the responsibility of the parties directly involved in the construction and finishing processes to insure that jobsite environmental conditions meet industry standards and the manufacturers' recommendations for the product(s) involved. This includes the architect/design professional(s), owner(s), general contractor, construction manager, and sub-contractor(s). Where multiple products or processes introduce different recommendations, the most critical limiting conditions must be identified and observed. It should be contractually established who has responsibility for jobsite environmental condition accountability. There should be an established procedure for determining the conditions in every area of the jobsite, monitoring those conditions, and maintaining a constant, acceptable environment. The best method for maintaining environmental conditions at acceptable levels during finishing and decorating is to use the central heating system (HVAC) of the building before, during, and after these operations commence. The environmental control systems in use should not be turned off after work hours or on weekends to avoid large swings in conditions, which would likely lead to problems. Use of unvented temporary heaters should be avoided. Unvented temporary heaters may produce fumes that can stain surfaces. These stains can then bleed through textures and paints to show on the completed finish. Unvented temporary heaters, such as propane or kerosene, also add water vapor to the air as they burn. This can significantly raise the humidity level and they typically produce uneven heat/humidity levels throughout the building. The biggest challenge with temporary heat is providing adequate ventilation so that the temperature and humidity are uniform and constant throughout the building. Heaters should not be allowed to blow directly on wall surfaces because excessive localized heating can cause rapid drying, leading to cracking and delamination. These challenges, and others, emphasize the need for a unified, detailed plan to address round-the-clock jobsite environmental conditions.

CONCLUSION

Controlling and maintaining environmental conditions is critical to minimizing potential problems during the finishing and decorating operations. These operations create the look and feel of the final space that the design professional intended and the occupants will utilize during the building's life. Failing to maintain good conditions during this critical phase of construction can create problems that will be costly and difficult to repair. In many cases, the costs of the repairs can exceed that of the original work. The closer your environment is to the marginal/poor range on the Joint Compound Drying chart, you significantly increase the chance that you will encounter some or all of the problems referenced in this document and perhaps more.

REFERENCES

The Gypsum Construction Handbook, 7th Edition, USG Corporation, John Wiley & Sons, In., 2014.

GA-214-21 *Levels of Finish for Gypsum Panel Products*, Gypsum Association. www.gypsum.org

GA-216-21 *Application and Finishing of Gypsum Panel Products*, Gypsum Association. www.gypsum.org

GA-236-17 *Joint Treatment Under Extreme Weather Conditions*, Gypsum Association. www.gypsum.org

Jobsite Conditions for Applying Interior Finishing Materials, Drywall Finishing Council, Inc. www.dwfc.org

Joint Compound Drying Time, Drywall Finishing Council, Inc. www.dwfc.org

PRODUCT INFORMATION

See usg.com for the most up-to-date product information.

TRADEMARKS

The trademarks USG, SHEETROCK, FIBEROCK, IT'S YOUR WORLD. BUILD IT., the USG logo, the design elements and colors, and related marks are trademarks of USG Corporation or its affiliates.

NOTICE

We shall not be liable for incidental or consequential damages, directly or indirectly sustained, nor for any loss caused by application of these goods not in accordance with current printed instruction or for other than the intended use. Our liability is expressly limited to replacement of defective goods. Any claim shall be deemed waived unless made in writing to us within thirty (30) days from date it was or reasonably should have been discovered.

NOTE

The information in this document is subject to change without notice. USG Corporation assumes no responsibility for any errors that may inadvertently appear in this document.

SAFETY FIRST!

Follow good safety and industrial hygiene practices during handling and installation of all products and systems. Take necessary precautions and wear the appropriate personal protective equipment as needed. Read Safety Data Sheets and related literature on products before specification and/or installation.

800 USG.4YOU
800 (874-4968)
usg.com/structural

Manufactured by
United States Gypsum Company
550 West Adams Street
Chicago, IL 60661

J2074/rev. 8-22
© 2022 USG Corporation and/or its
affiliates. All rights reserved.
Printed in U.S.A.

USG 
IT'S YOUR WORLD. BUILD IT.®